

<b>AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT</b>				1. CONTRACT ID CODE	PAGE 1 OF 2 PAGES
2. AMENDMENT/MODIFICATION NO. AMENDMENT NO. 0002		3. EFFECTIVE DATE 08-30-10	4. REQUISITION/PURCHASE REQ. NO.	5. PROJECT NO. (If applicable) 09-0093	
6. ISSUED BY CODE ltc  Officer in Charge of Construction MCI-East 1005 Michael Road Camp Lejeune, NC 28547-2521			7. ADMINISTERED BY (If other than Item 6) CODE  See Item 6		
8. NAME AND ADDRESS OF CONTRACTOR (No., street, county, State and ZIP Code)				(X)	9A. AMENDMENT OF SOLICITATION NO.  N40085-09-R-0093
				X	9B. DATED (SEE ITEM 11)  08-20-10
					10A. MODIFICATION OF CONTRACT/ORDER NO.
					10B. DATED (SEE ITEM 11)
CODE		FACILITY CODE			

**11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS**

The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offers  is extended,  is not extended.  
 Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods:  
 (a) By completing items 8 and 15, and returning 0 copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted;  
 or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment your desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.

12. ACCOUNTING AND APPROPRIATION DATA (If required)

**13. THIS ITEM ONLY APPLIES TO MODIFICATION OF CONTRACTS/ORDERS.  
IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.**

CHECK ONE	A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.
	B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(b).
	C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:
	D. OTHER (Specify type of modification and authority)

E. IMPORTANT: Contractor  is not,  is required to sign this document and return \_\_\_\_\_ copies to the issuing office.

14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.)

Project 09-0093 Upgrade & Replace Fire Alarm Systems, Various Buildings

Question: Drawing E1.53 Building 700 appears to be blank. Will a drawing be provided for this building?

Answer: Incorporate attached drawing E1.53.


Except as provided herein, all terms and conditions of the document referenced in Item 9A or 10A, as heretofore changed, remains unchanged and in full force and effect.

15A. NAME AND TITLE OF SIGNER (Type or print)		16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print)	
15B. CONTRACTOR/OFFEROR		16B. UNITED STATES OF AMERICA	16C. DATE SIGNED
(Signature of person authorized to sign)		(Signature of Contracting Officer)	


REVISIONS				
SN	ZONE	DESCRIPTION	DATE	APPROVED

GENERAL NOTES:  
 1. ALL PLANS REFER TO DETAIL DRAWINGS E4.01 AND E4.02.

- DRAWING NOTES:
- ① REMOVE EXISTING FIE-LITE MS. 8 ZONE FIRE ALARM CONTROL PANEL. EXISTING FIRE ALARM WIRING AND 120V. POWER TO REMAIN. REPLACE EXISTING FIRE ALARM SYSTEM CONTROL PANEL WITH NEW ADDRESSABLE CONTROL PANEL. RECONNECT ALL EXISTING WIRING.
  - ② REMOVE EXISTING RADIO FREQUENCY TRANSMITTER. REMOVE EXISTING WIRE AND CONDUIT. REPLACE EXISTING TRANSMITTER WITH NEW DIGITAL ALARM COMMUNICATOR TRANSMITTER AND EXTENDER PANEL. CONNECT TO NEW FIRE ALARM CONTROL PANEL.
  - ③ REMOVE EXISTING ANTENNA. WIRE AND CONDUIT. REPAIR OPENING IN WALL AND MAKE WATER-TIGHT.
  - ④ PROVIDE 1" C. WITH TWO CAT5E CABLES TO TELEPHONE TERMINAL CLOSET AND MAKE ALL FINAL CONNECTIONS.
  - ⑤ PROVIDE SMOKE DETECTOR ON CEILING ADJACENT TO THE REPLACEMENT FIRE ALARM CONTROL PANEL.

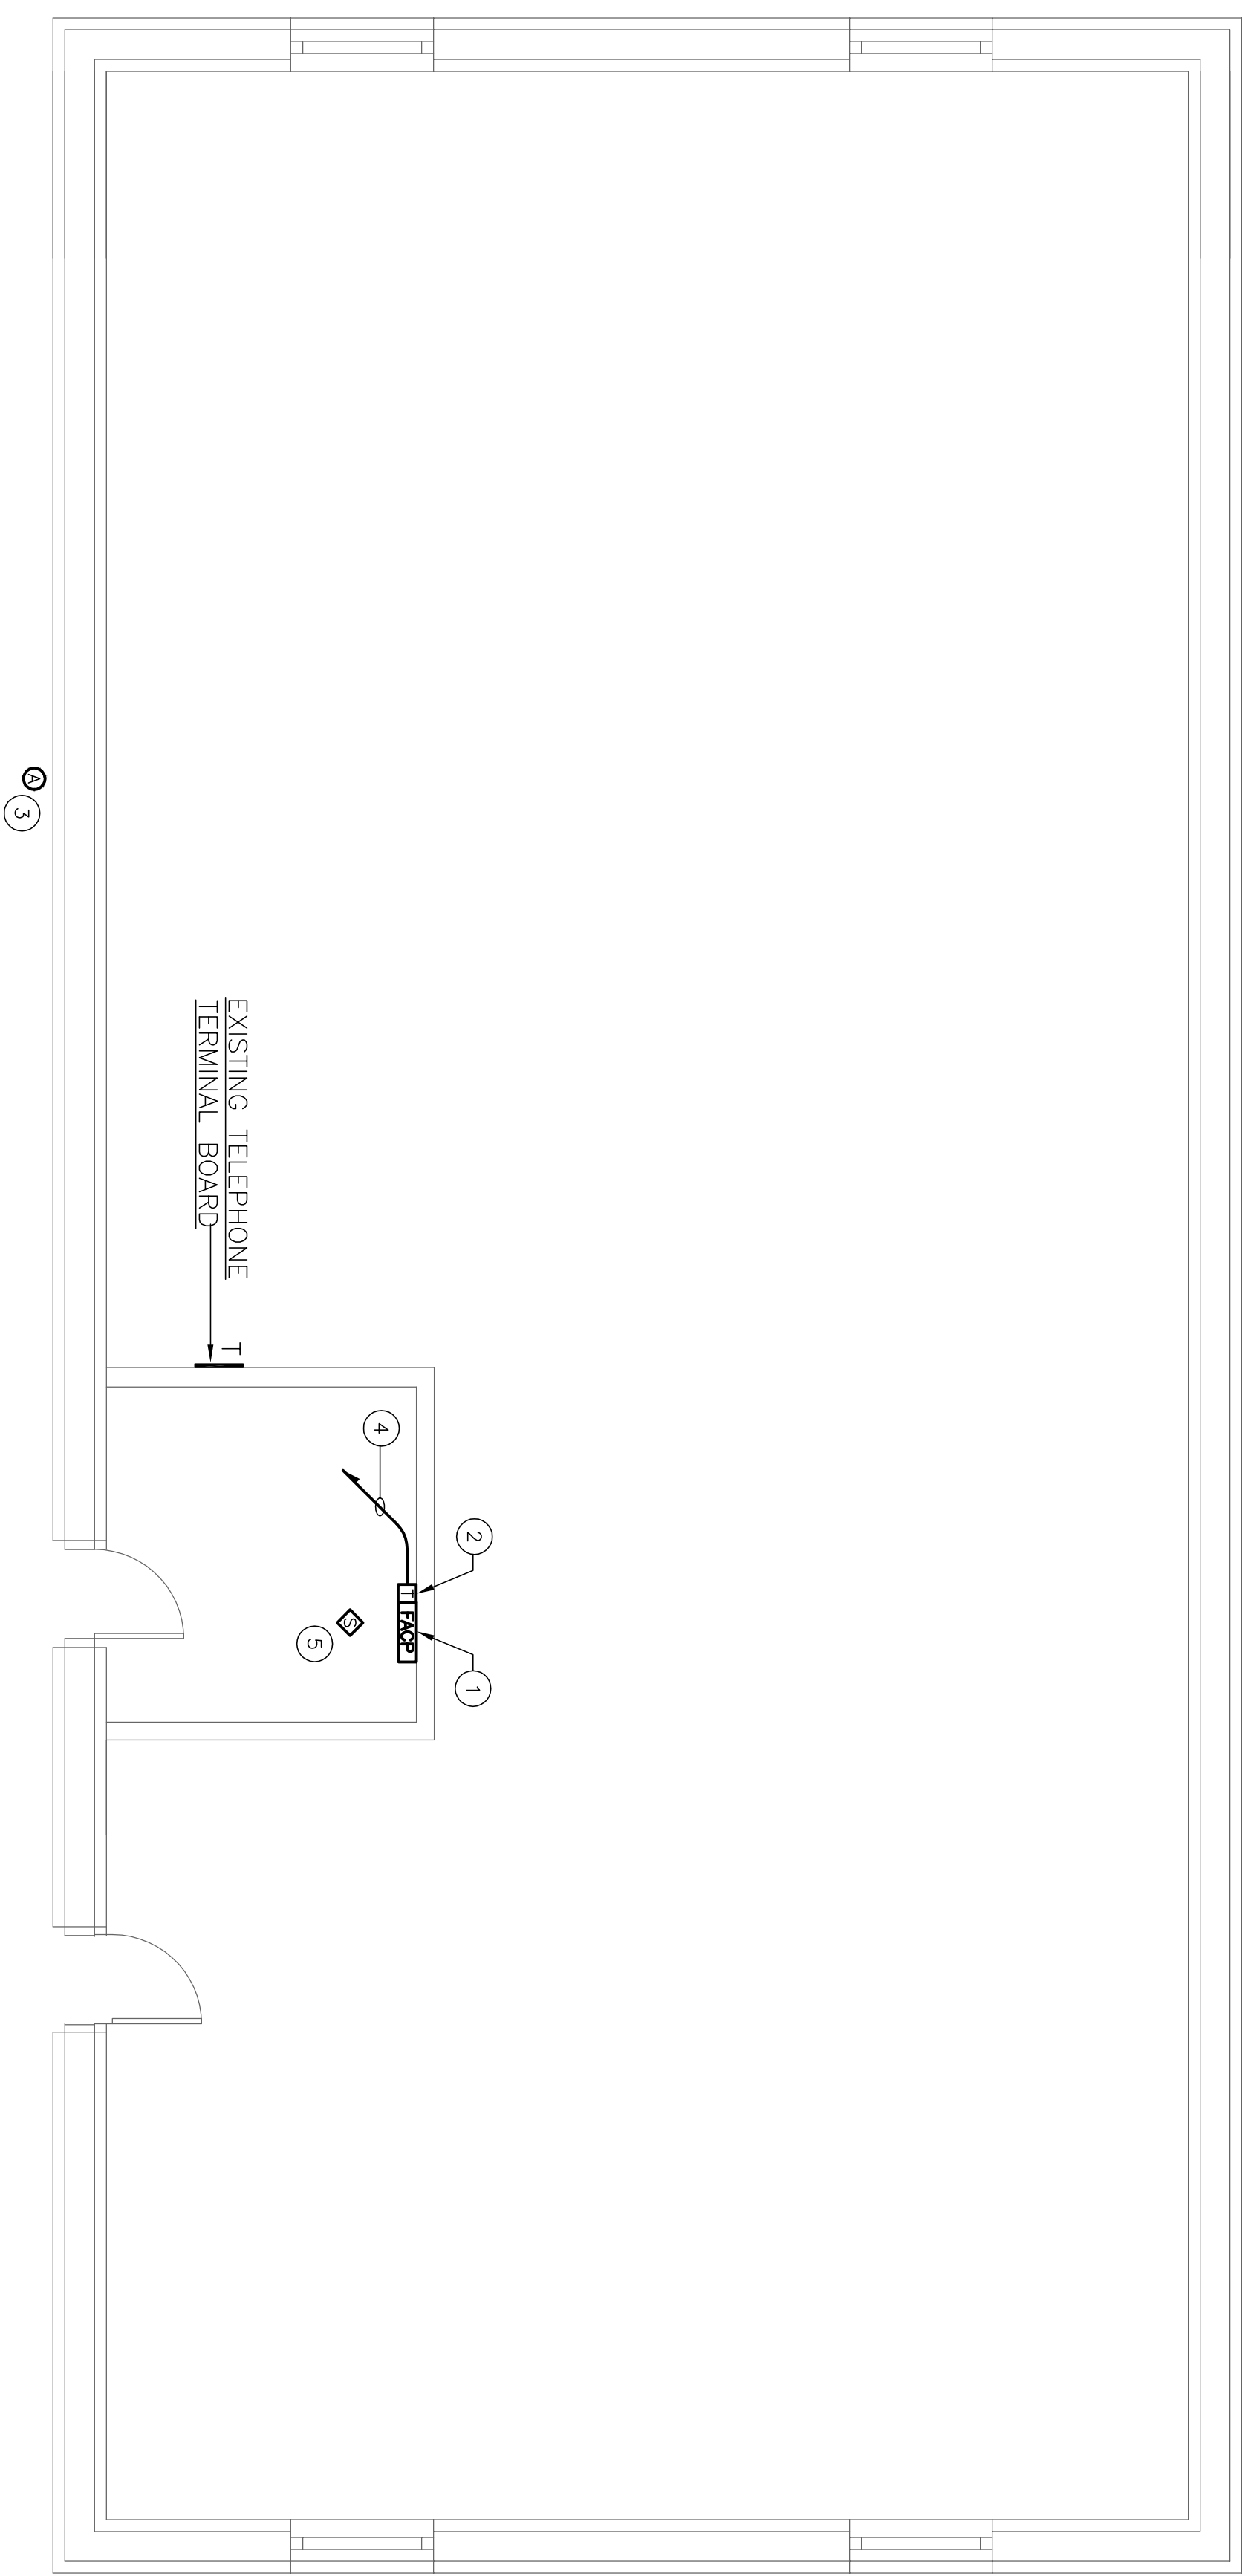

FIRST FLOOR PLAN

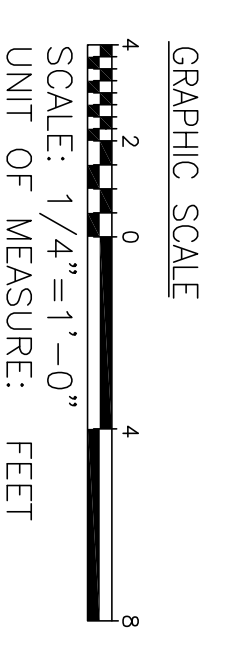

DATE: <b>7/30/2010</b>	<b>FINAL SUBMISSION</b>	<b>E1.53</b>
FACILITY ENGINEERING DEPT DWG NO.		DEPT OF NAVY <b>MARINE CORPS BASE, CAMP LEJEUNE, N.C.</b> PUBLIC WORKS DIVISION
DES: OAS	UPGRADE AND REPLACE FIRE ALARM SYSTEMS, VARIOUS BUILDINGS	
DR: MCW	BUILDING NO. 780 FIRST FLOOR	
CHK: EJM	FIRE ALARM SYSTEM	
SUPV: JWM	NAVJG DRAWING NO. 60006413	
IN CH:	APPROVED: FEO OR OICC	DATE
SATISFACTORY TO	DATE	SCALE NOTED) SPEC: 09-0093

